

Certyfikat PN-EN 14351-1+A2



Laboratorium Techniki Budowlanej

Sp. z o.o.

41-306 Dąbrowa Górnicza, ul. Łaski 83 ; NIP 629-24-65-943
tel./fax (+48) 32 264 079; LTB@LTB.org.pl

KRS 0000447876; REGON 243165500

Wysokość kapitału zakładowego: 66 000 PLN Sąd Rejonowy Katowice-Wschód XII
Wydział Gospodarczy Krajowego Rejestru Sądowego; Kapitał zakładowy opłacony w całości

Rok założenia: 2000

System zarządzania (ISO/IEC): EN 17025
Jednostka notyfikowana (NB): 1827
Jednostka akredytowana (AB): 661
Członek komitetu technicznego: PKN KT 169
Członek komitetu technicznego: PKN KT 179
Członek komitetu technicznego: CEN TC 33

Evidence of testing in purpose to establish product type (TT) according to Standard EN 14351-1+A2

№ 732/B – 2020/2/E – 2

Laboratorium Techniki Budowlanej used the calculation method, in accordance with Standard EN ISO 10077-1:2017 and EN ISO 10077-2:2017, to define the thermal insulation of windows


Fenster 500

system described in test report 732/B-2020/2/E, manufactured by:

LLC TERVIKNOPLAST

46002 Ternopil, 38 S. Bandera Ave, Ukraine

Test's results	
Cross section	Frame / Leaf
U_f [W/m ² K]	1,5
ψ [W/mK]	0,076
IGU U_g [W/m ² K]	0,7 (4/10/4/10/4)
U_w [W/m ² K] for window 1,23 x 1,48 m	1,1
The results of the examination refer only to the tested sample and the test conditions. The parameters for other constructions should be declared in compliance with the provisions specified in standard EN 14351-1+A2.	

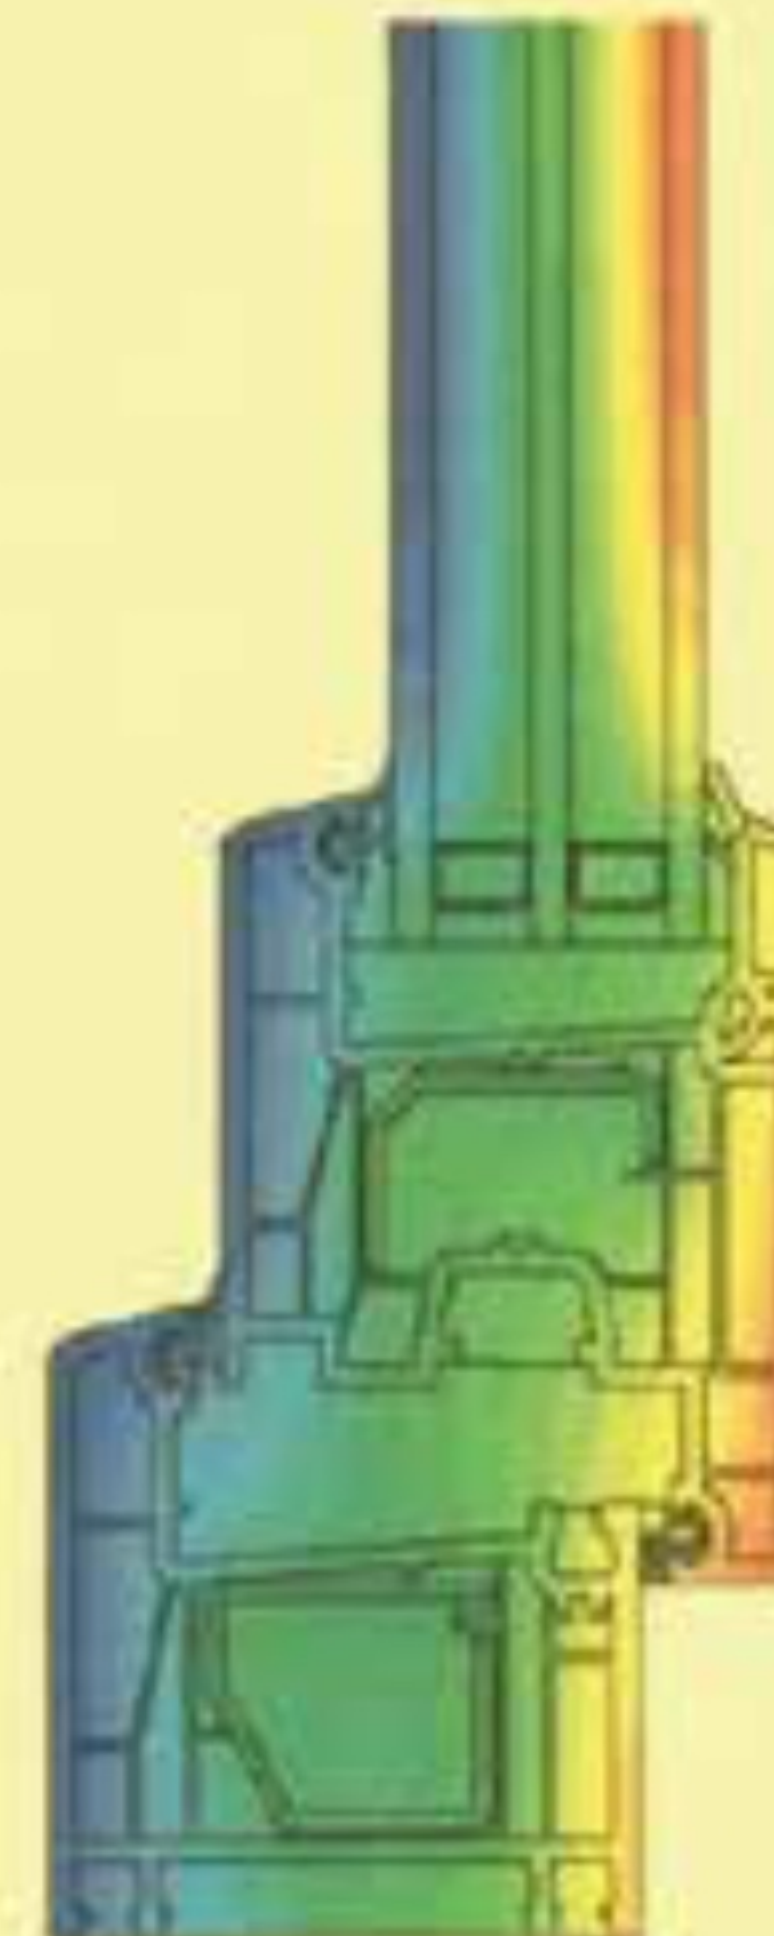

Quality Manager

Maciej Żyła
Maciej Żyła



Engineering Manager

Bogdan Wójtowicz
mgr inż. Bogdan Wójtowicz

Dąbrowa Górnicza, dated 9TH December 2020